


SÉRIE 719 MN S

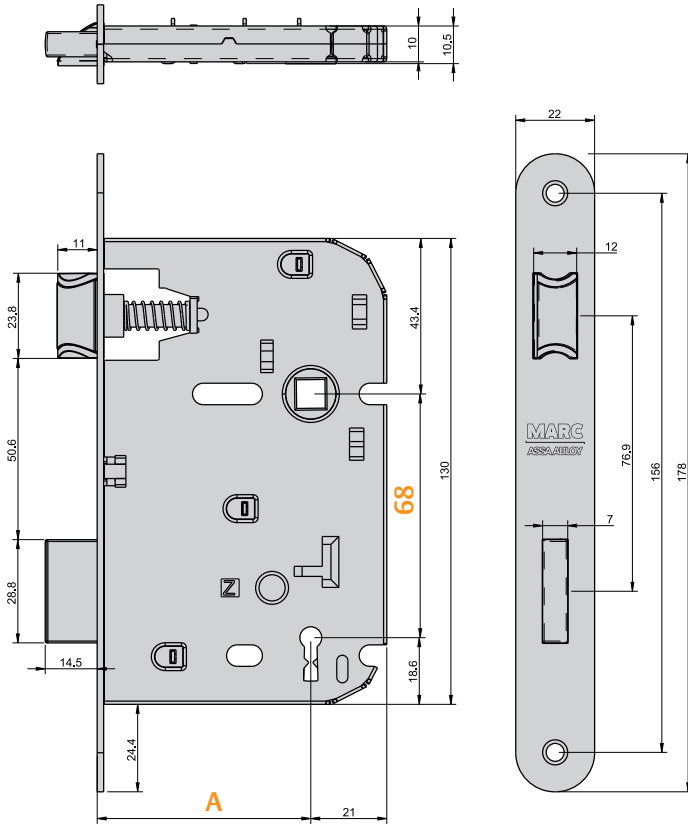

Optional - Optional
Option - Optionen

PT	CZ	2Z (60)	1Z
EN	Key lock	WC lock (60)	Latch lock
FR	Clé-L	BdCC (60)	BdC
DE	BB-Schloss	WC-Schloss (60)	Fallenschloss

NORMA • STANDARD • NORME • NORM • EN12209



Testes realizados no nosso laboratório de fábrica - Tests made in our factory lab
Testes réalisés en notre laboratoire d'usine - Im Marques-Labor geprüft und bestätigt

A	B	C
55	68	6,5
60		8
65		