


SÉRIE 528.92




MAGNET

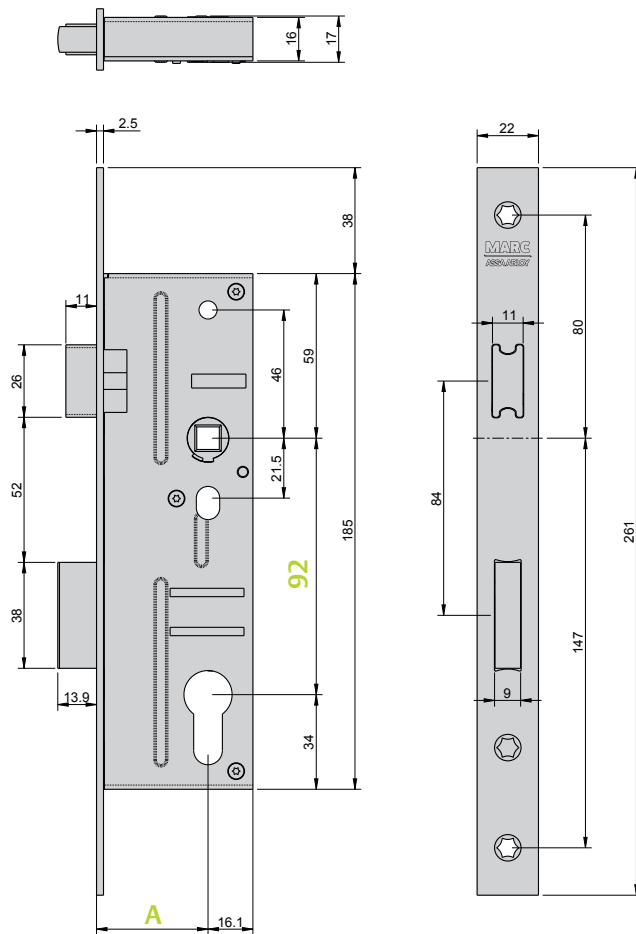

A				B		C	
25	30	35	40	92	8		



PT	CIL
EN	PC lock
FR	Clé-I
DE	PZ-Schloss

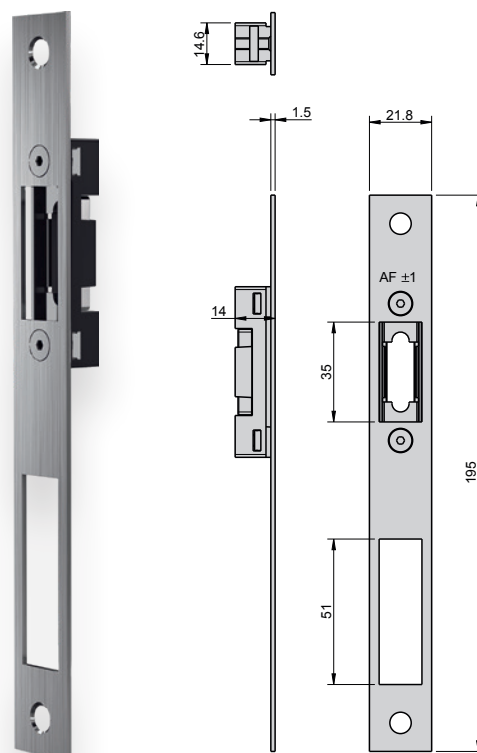

NORMA • STANDARD • NORME • NORM • EN12209



Testes realizados no nosso laboratório de fábrica - Tests made in our factory lab
Testes réalisés en notre laboratoire d'usine - Im Marques-Labor geprüft und bestätigt